

NOTICE
THIS DRAWING IS THE PROPERTY OF QualiTROL COMPANY LLC AND IS LOANED ONLY ON THE CONDITION THAT IT WILL BE USED TO FACILITATE THE PURPOSE FOR WHICH INTENDED AND NOT BE REPRODUCED, COPIED OR OTHERWISE DISPOSED OF, AND IS NOT TO BE USED IN WHOLE OR PART FOR FURNISHING INFORMATION RELATIVE TO THE MAKING OF DRAWINGS, PARTS APPARATUS OR PARTS THEREOF, EXCEPT BY WRITTEN ORDER FROM QualiTROL COMPANY LLC.

MODEL
NO.

092-300-02

NOTES:

ALL DIMENSIONS ARE IN INCHES [MILLIMETERS], FOR REFERENCE ONLY.

CASE IS INTENDED FOR VERTICAL MOUNTING ONLY.

CASE IS VENTED CONFORMS TO IP65.

DIAL: BLACK BACKGROUND


POINTER: YELLOW

LENS: GLASS

CASE: ALUMINUM, PAINTED ASA 70, LIGHT GRAY EPOXY

TORQUE IS ADJUSTABLE BETWEEN 4-8 IN OZ.


INSULATION TEST: 2000 VOLTS TO GROUND FOR 60 SECONDS

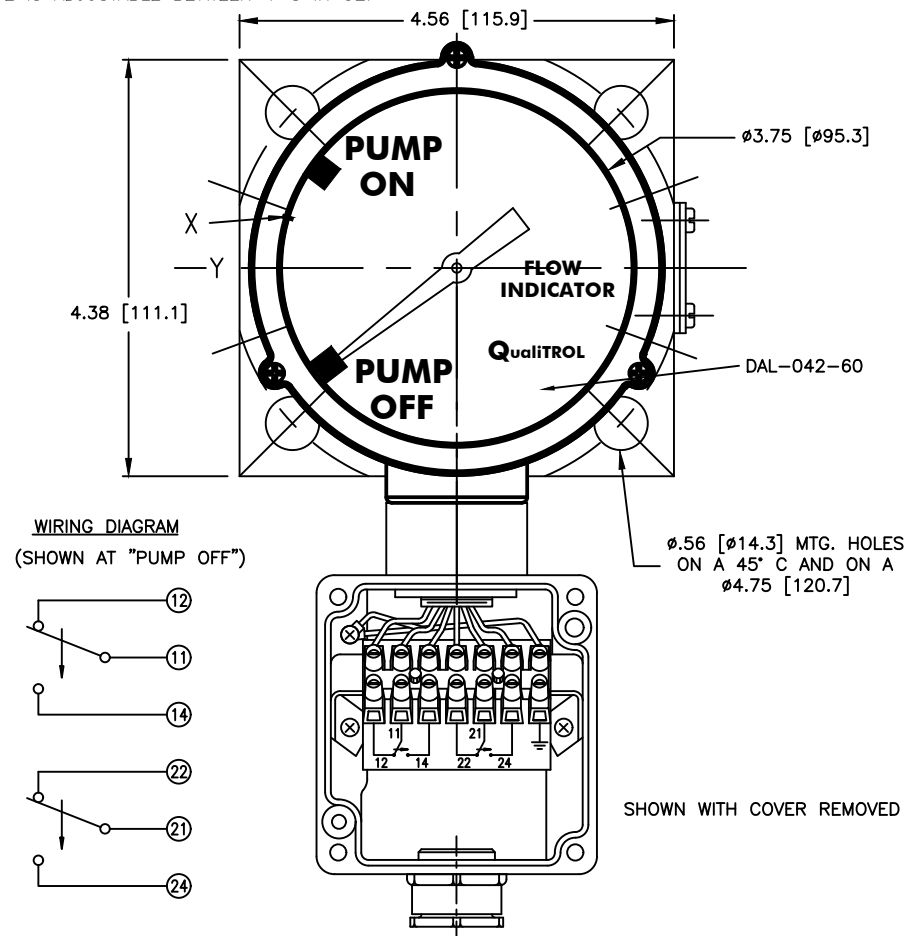

11 AND 12, AND 21 AND 22, ARE CLOSED AT "PUMP OFF",
OPENING ON INCREASING FLOW AT "X".
ON DECREASING FLOW 11 RECLOSSES ON
12, AND 21 RECLOSSES ON 22, BEFORE "Y"

SWITCH RATING:

10 AMPS AT 125, 250, 480 VAC
1/2 AMP AT 125 VDC - NON INDUCTIVE
1/4 AMP AT 250 VDC - NON INDUCTIVE

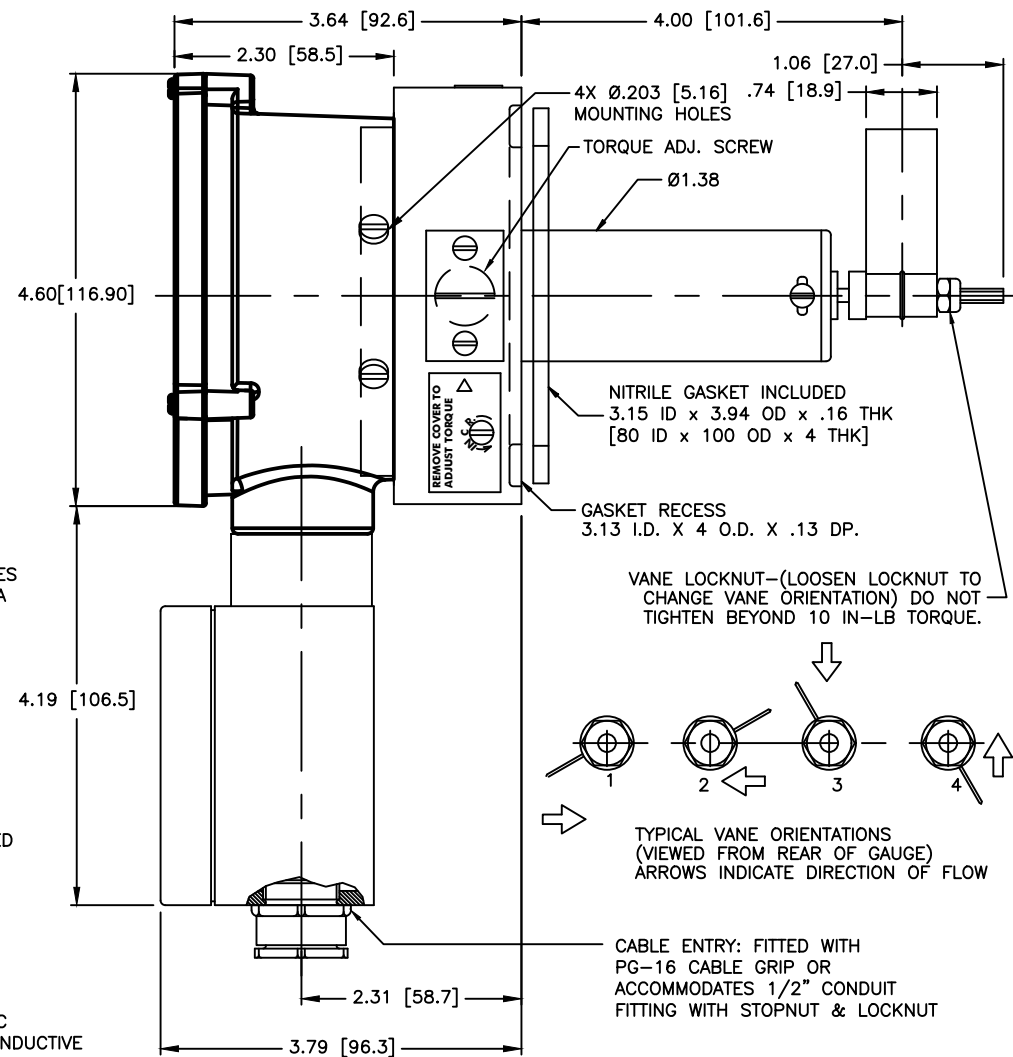

TYPICAL VANE ORIENTATIONS
(VIEWED FROM REAR OF GAUGE)
ARROWS INDICATE DIRECTION OF FLOW

-	3/16/20	UPDATE CAS/BEZ TO IP65	37689
-	5-8-02	ADDED NITRILE GASKET	22878
-	7-17-01	ADDED CABLE GRIP (P/N ADP-152-1)	22331
LET	DATE	ALTERATION	C.N.

QUALITROL.

DIMENSIONS AND TOLERANCES IN
ACCORDANCE WITH ASME Y14.5M-1994

PH. (585) 586-1515
FAX (585) 377-0220

1385 FAIRPORT ROAD
FAIRPORT, NY 14450
FORM 0-473 REV. F 04/06/06

TITLE:

3.5 FLOW GAGE-2 SW.

MODEL
NO.

092-300-02