


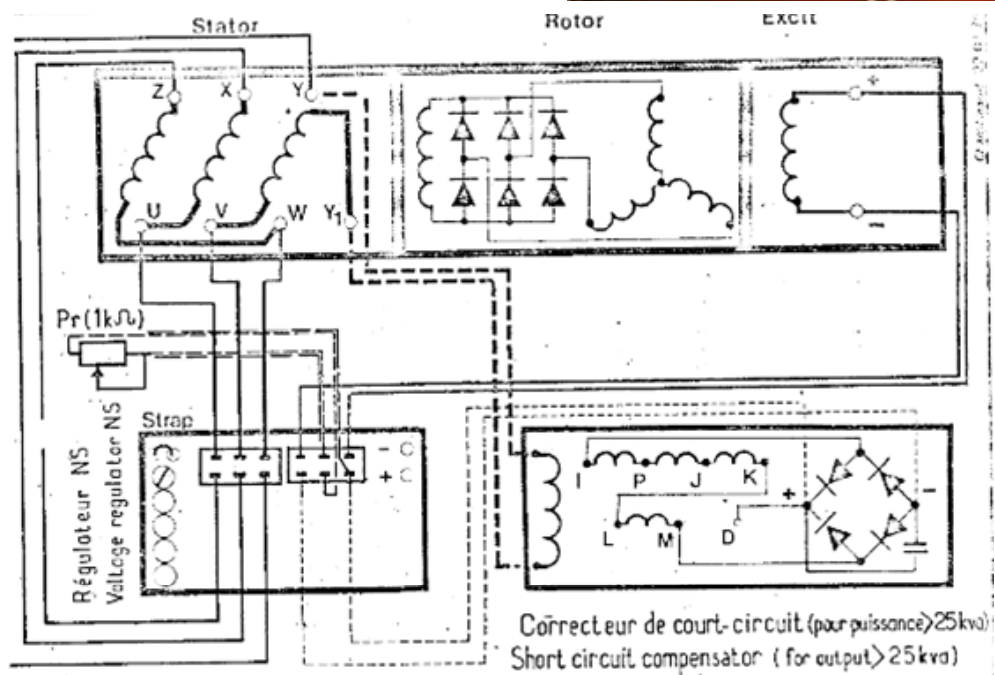


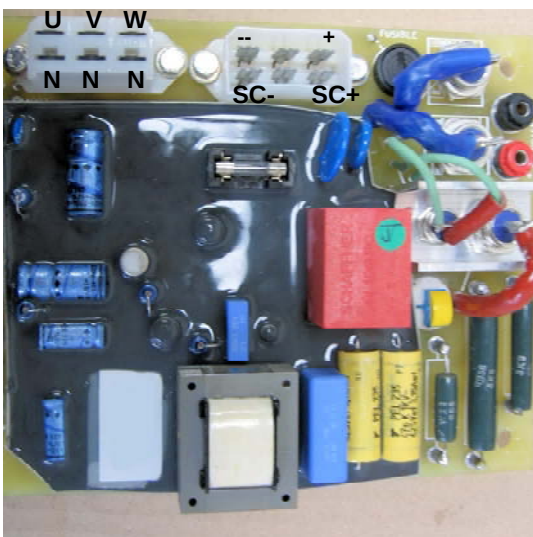


Unelec Alstohm RS182, 15066-1954 FRM-FRN H21506	
ENG	MTR
DATE	17-03-2010
VERSION	V1.0
PAGE	2/2

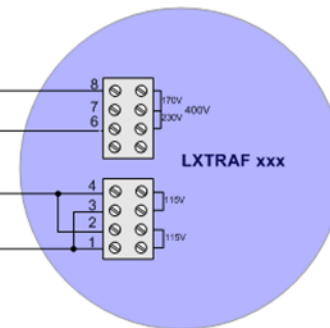

Unelec_LX100.vsd

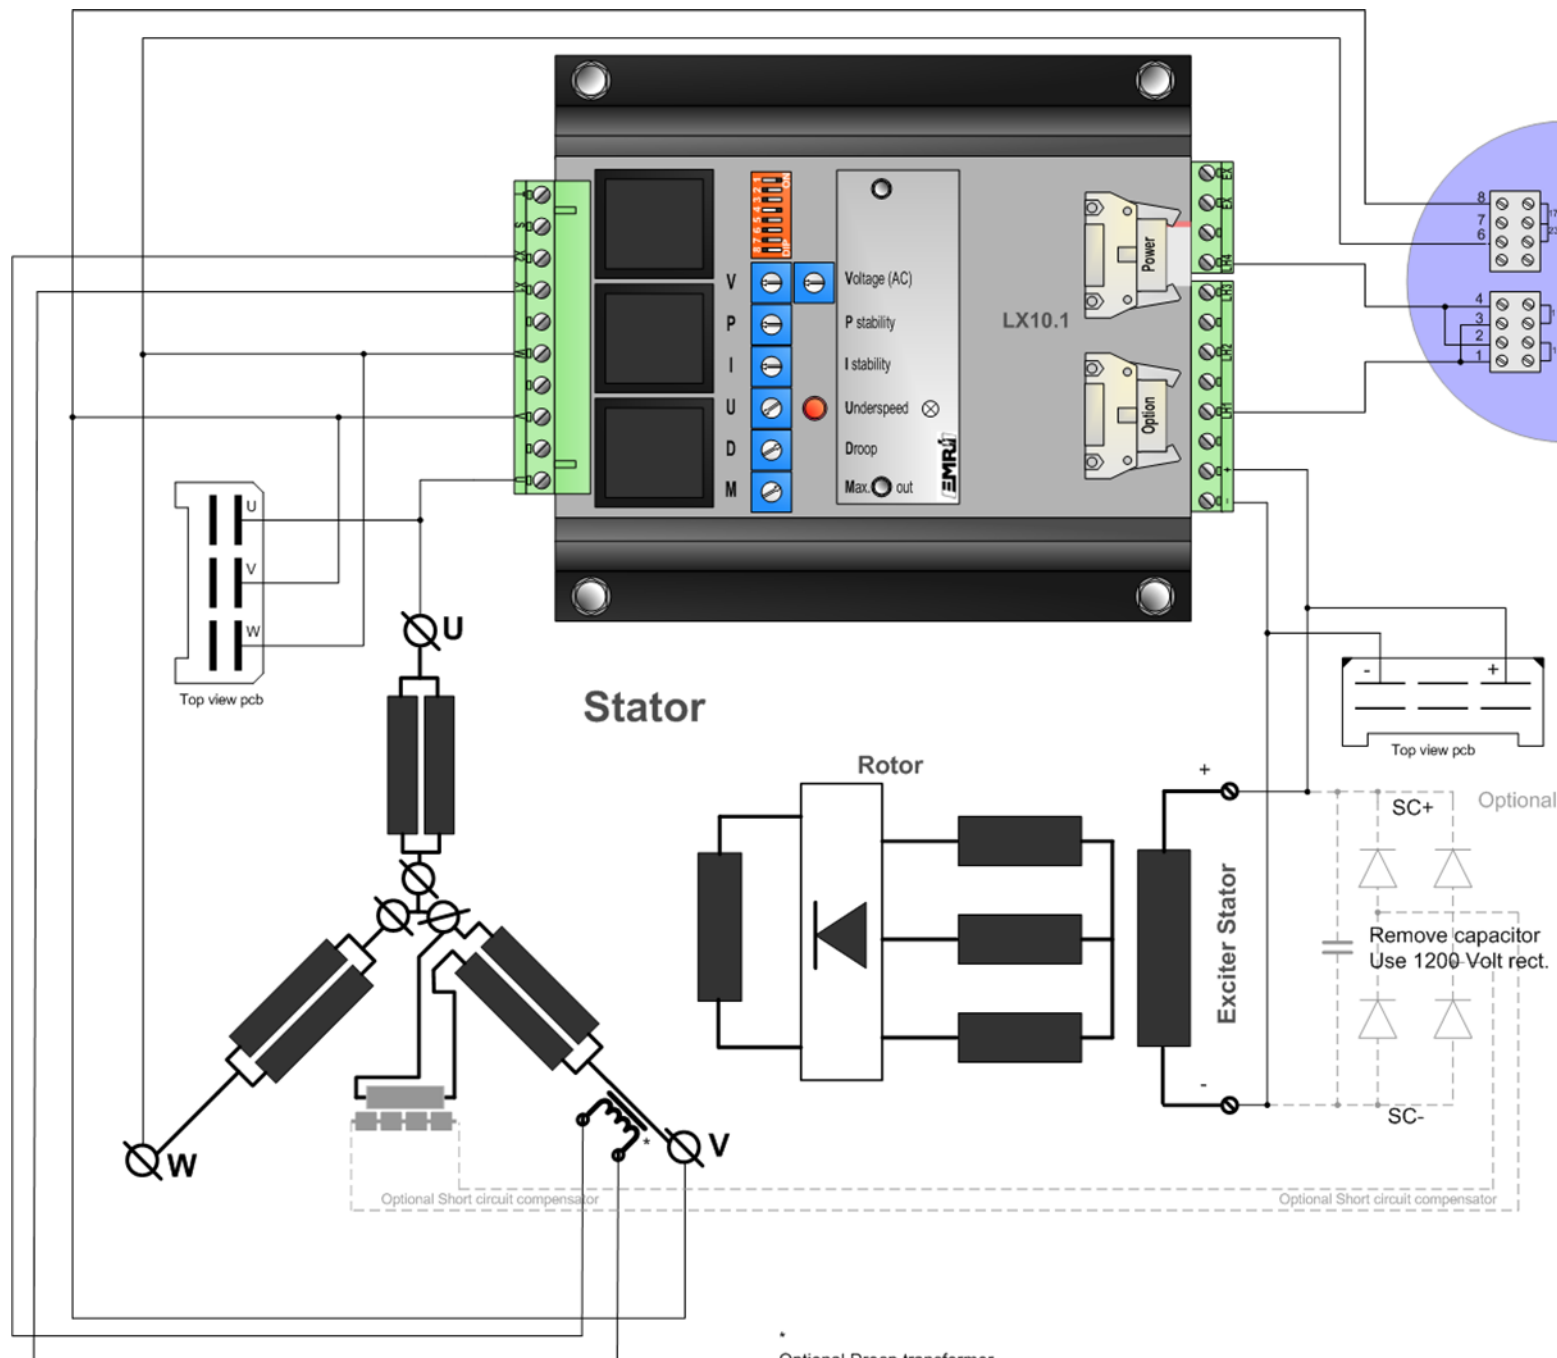

TRAFLEXTRAF for use at generators approx. 200 kVA and more, or if the exciter stator insulation is poor. Use of a transformer improves reliability

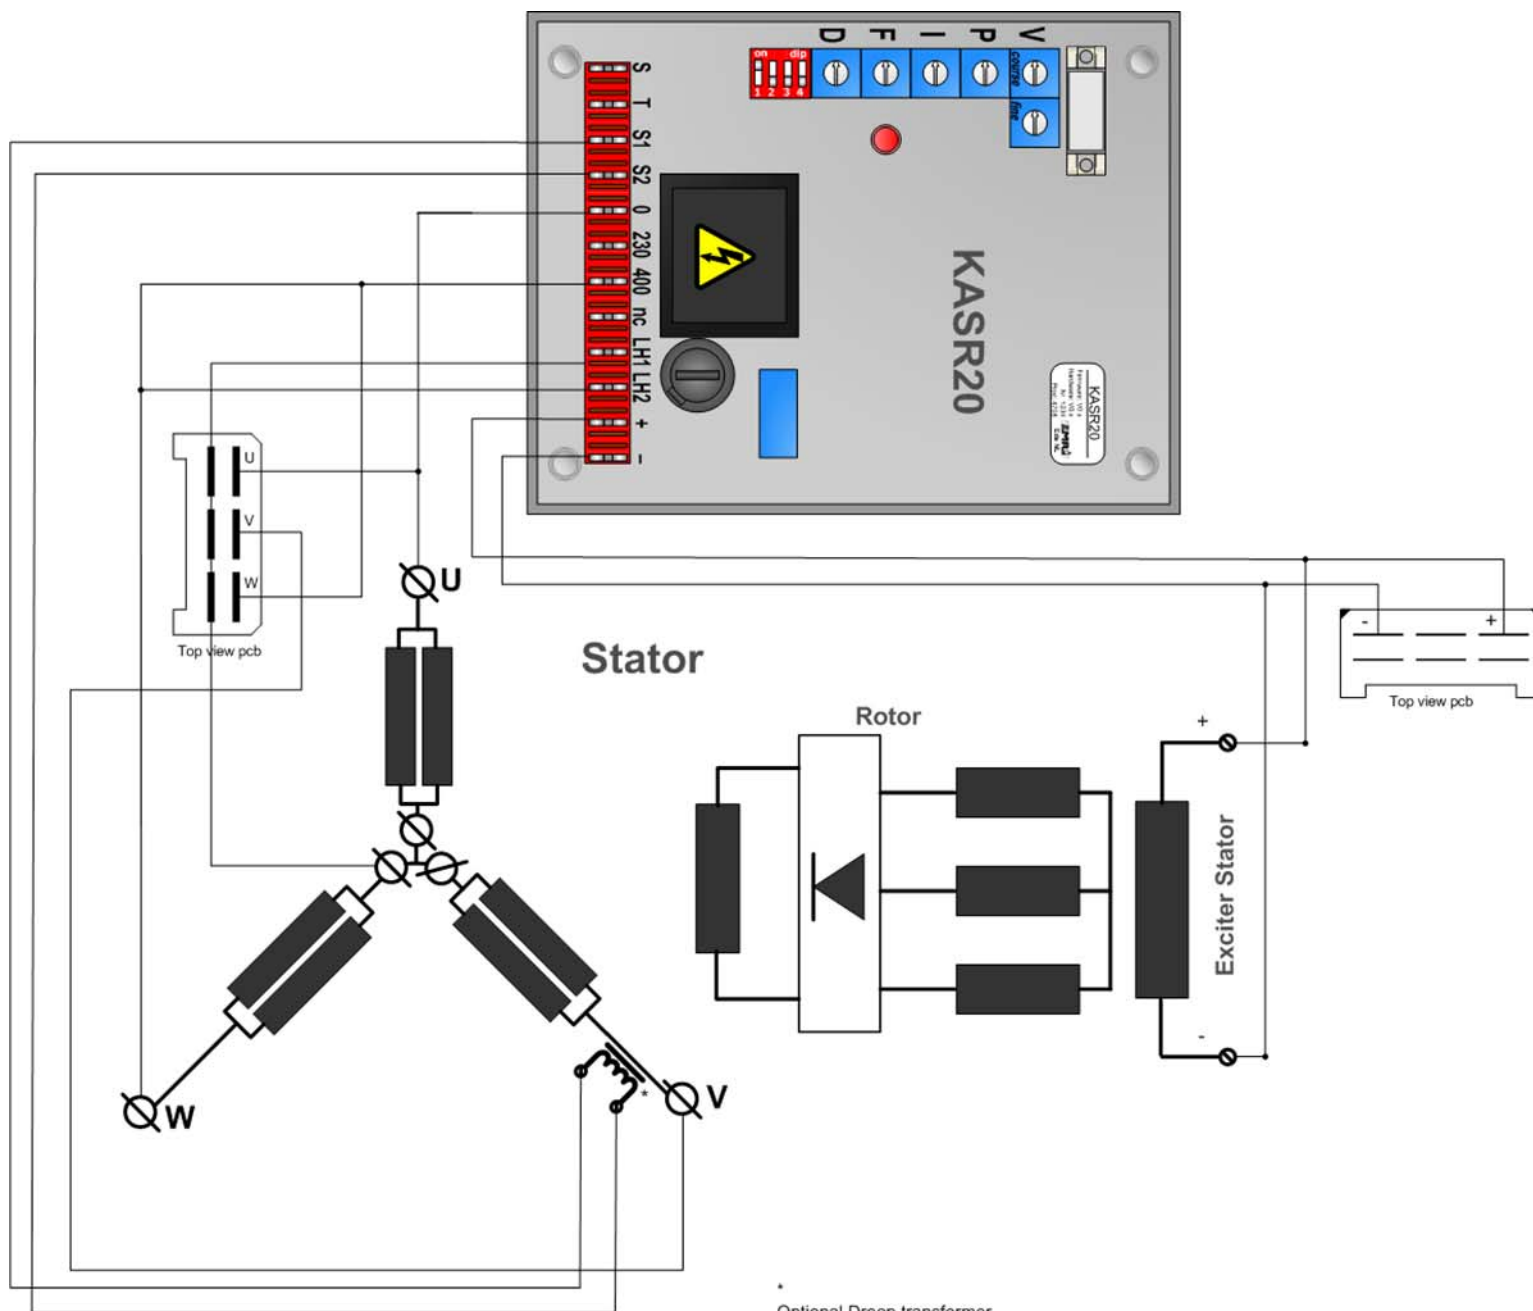

*
Optional Droop transformer
for parallel operation

Unelec Alstohm RS182, 15066-1954 FRM-FRN H21506		
ENG	MTR	
DATE	17-03-2010	
VERSION	V1.0	
PAGE	1/2	