

conduleT divergent

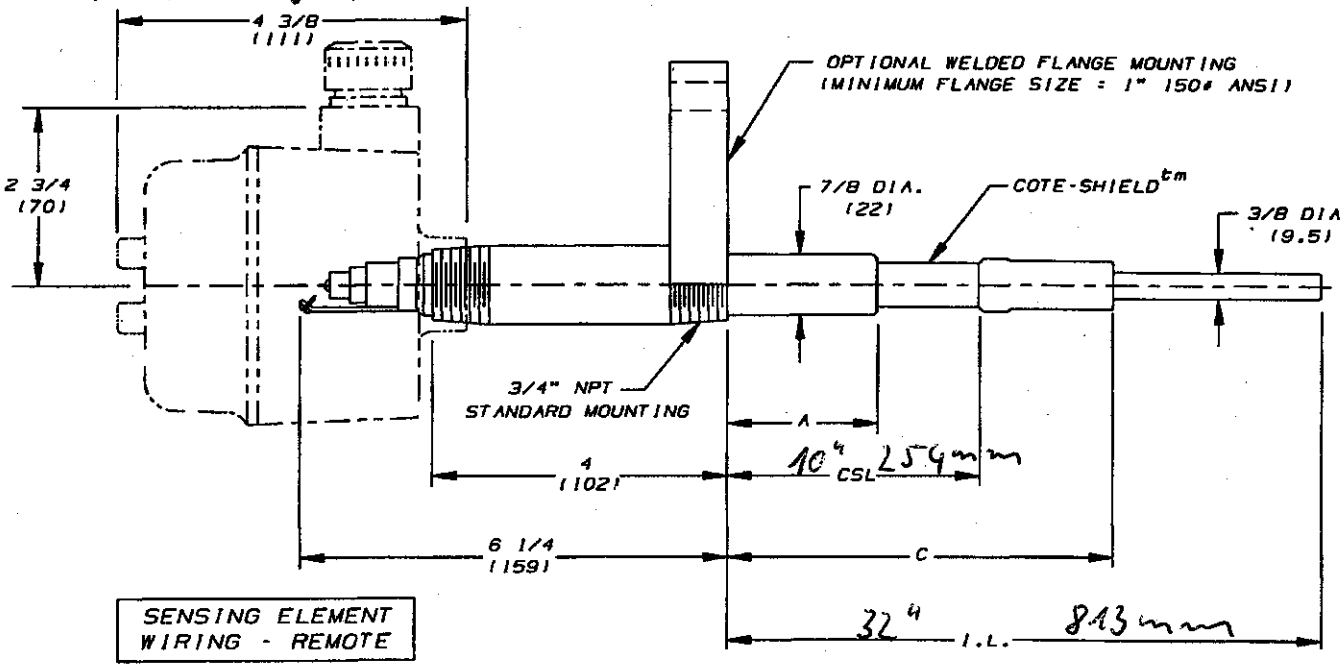

STANDARD DIMENSIONS			
A	CSL	C	I.L.
2 (51)	3 1/2 (89)	5 1/2 (140)	18 (457)
4 (102)	10 (254)	12 (305)	18 (457)
4 (102)	10 (254)	12 (305)	36 (915)
4 (102)	10 (254)	12 (305)	72 (1829)

SENSING ELEMENT
WIRING - REMOTE

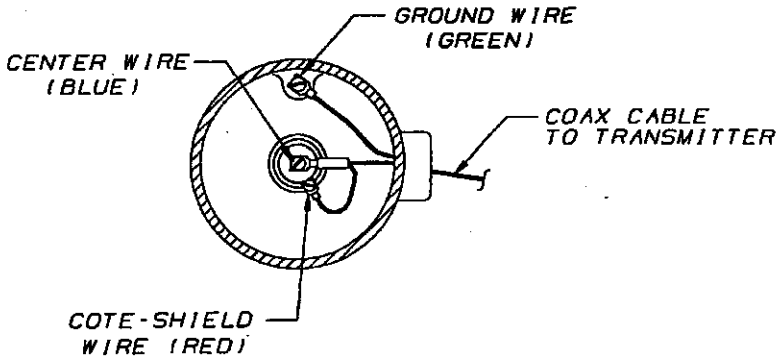

NOTES:
1. METAL WETTED PARTS ARE 316 STAINLESS STEEL.
2. INSULATION MATERIAL IS A HIGH PERFORMANCE THERMOPLASTIC.
3. OPTIONAL DRILLED AND TAPPED FLANGE MOUNTING AVAILABLE. (MINIMUM FLANGE SIZE = 1" 150# ANSI.)
4. REMOTE INSTALLATION SHOWN.

tm- TRADEMARK OF DREXELBROOK ENG. CO.

CERTIFIED by
PO #
ENG
USER
DE #

ISS.	EDO/DSR NO.	APP'D	DATE
3	10-95-163	EJL	11/6/95
2	3-94-188	JEN	5-9-94
1	5-93-166	JEN	11-3-93

COPYRIGHT 1995
DREXELBROOK ENG CO.

SCALE NONE
UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)

DR. JL 11-6-95
CK. WAL


DREXELBROOK
Engineering Company
205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

3-TERMINAL PERM-A-SEAL SENSING ELEMENT REMOTE OR INTEGRAL

700-1202-001-CD SHT. 1 OF 1 ISS. 3

440-115-184 (2)

NO. 700-1202-001-CD SHT 1 OF 1

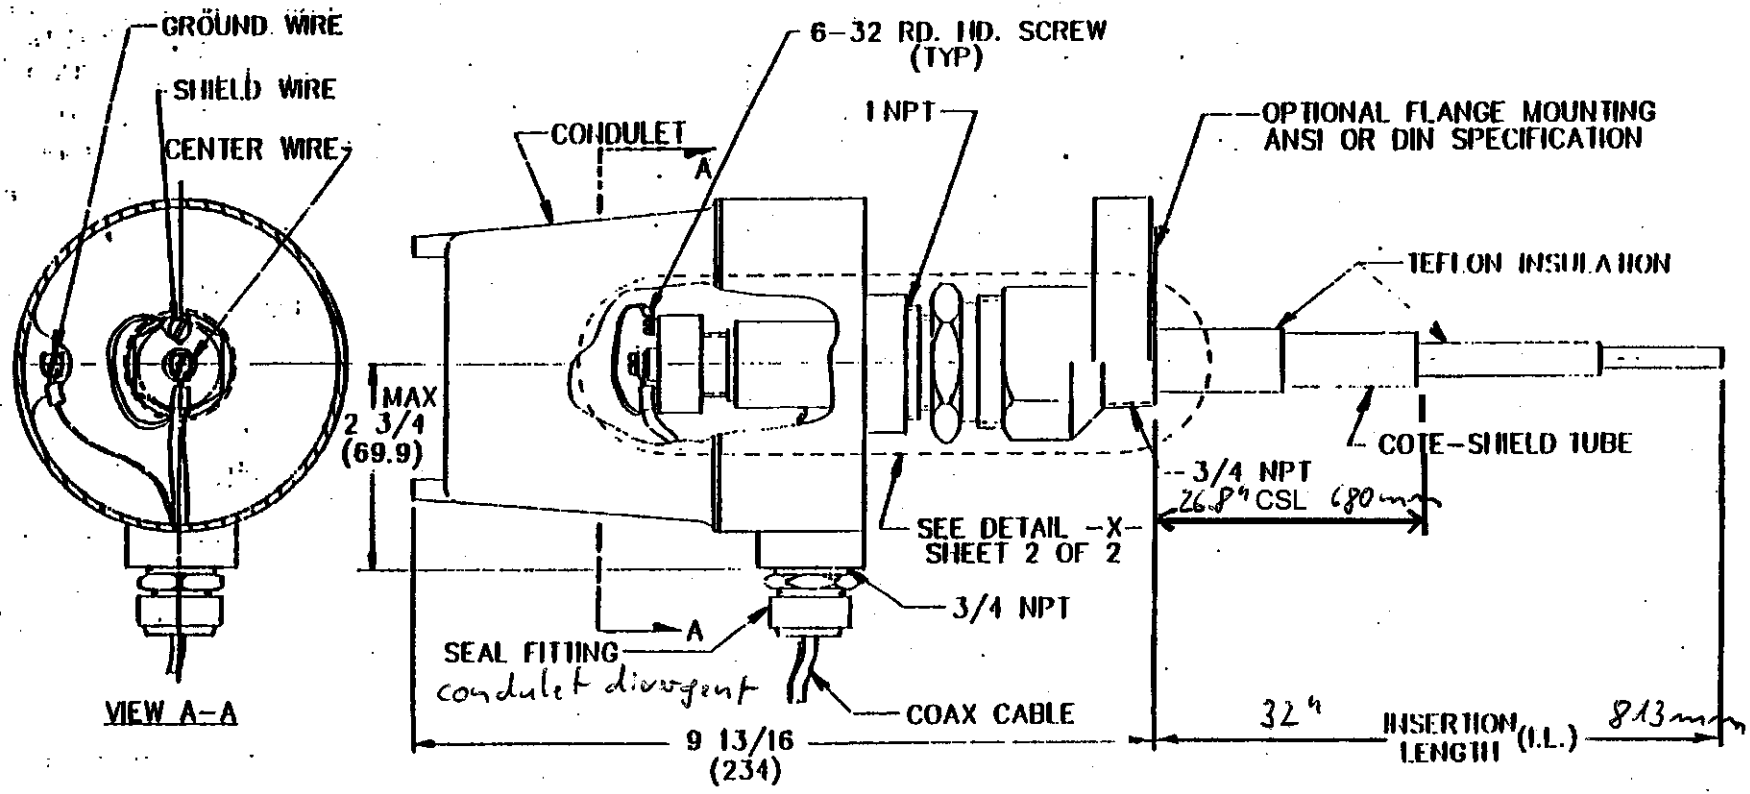

1	6-89-168	CdC	7/21/89		

CERTIFIED by
PO #
ENG
SER

COPYRIGHT 1989
DREXELBROOK ENG. CO

SCALE NONE
UNLESS OTHERWISE STATED
ALL DIMENSIONS IN INCHES (MM)

DR. CDW
CK. ASK

DTE
Drexelbrook
Engineering Company
205 KEITH VALLEY RD
HORSHAM, PA 19044-9986

COTE-SHIELD
SENSING ELEMENT

700-202-2-CD

SHT 1 OF 2

700-202-8-CD