
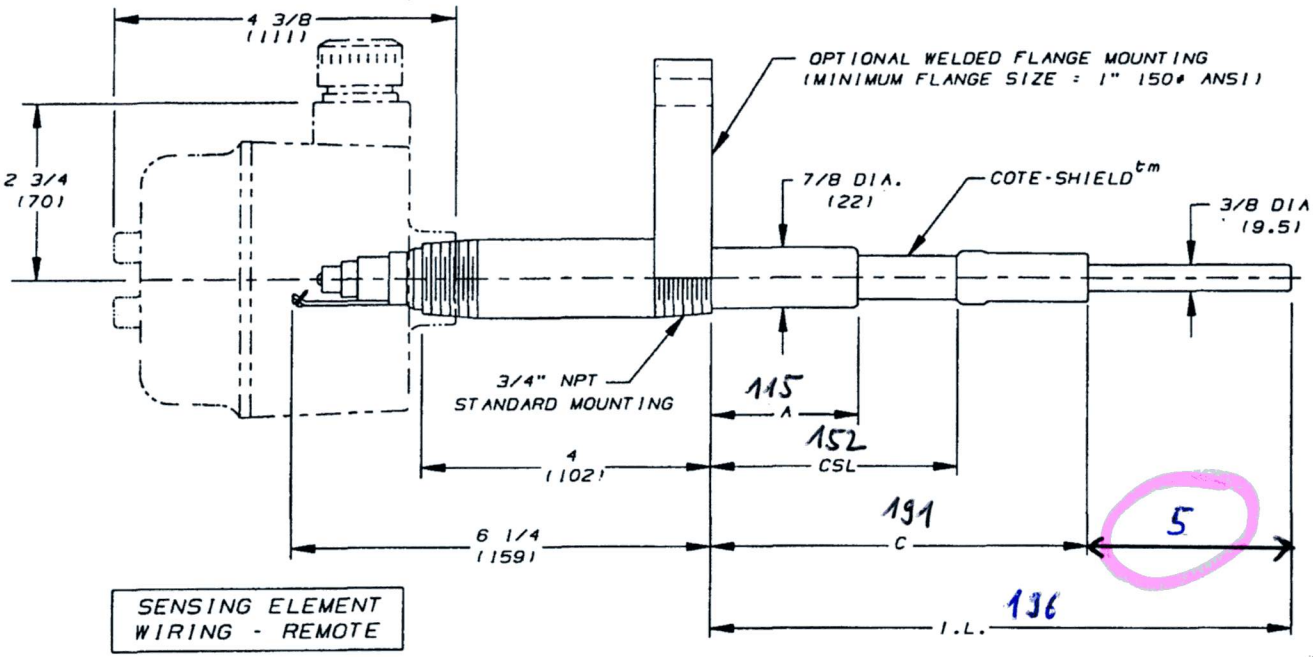


STANDARD DIMENSIONS			
A	CSL	C	I.L.
2 (51)	3 1/2 (89)	5 1/2 (140)	18 (457)
4 (102)	10 (254)	12 (305)	18 (457)
4 (102)	10 (254)	12 (305)	36 (915)
4 (102)	10 (254)	12 (305)	72 (1829)

SENSING ELEMENT WIRING - REMOTE

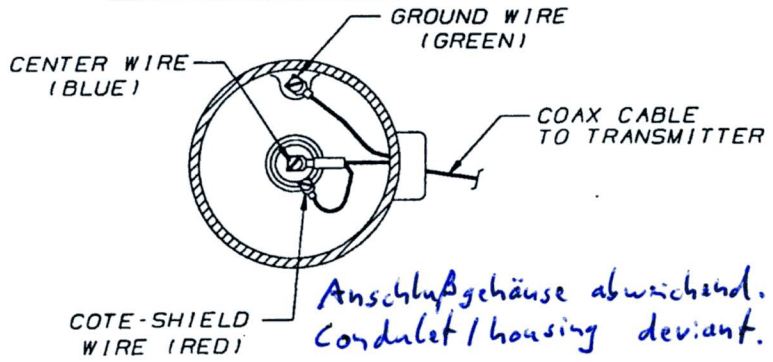

Anschlußgehäuse abweichend.
Conduit/housing deviant.

NOTES:
1. METAL WETTED PARTS ARE 316 STAINLESS STEEL.
2. INSULATION MATERIAL IS A HIGH PERFORMANCE THERMOPLASTIC.
3. OPTIONAL DRILLED AND TAPPED FLANGE MOUNTING AVAILABLE. (MINIMUM FLANGE SIZE = 1" 150# ANSI.)
4. REMOTE INSTALLATION SHOWN.

tm- TRADEMARK OF DREXELBROOK ENG. CO.

CERTIFIED by
PO #
ENG
USER
DE #

ISS.	EDO/DSR NO.	APP'D	DATE
3	10-95-163	EdA 11/6/95	
2	3-94-168	JEN	5-9-94
1	5-93-166	JEN	11-3-93

COPYRIGHT 1995
DREXELBROOK ENG CO.

SCALE NONE
UNLESS OTHERWISE STATED ALL DIMENSIONS IN INCHES (MM)

DR. JL 11-6-95
CK. WAL

DREXELBROOK
Engineering Company
205 KEITH VALLEY RD
HORSHAM, PA 19044-9986
215-674-1234
FAX 215-674-2731

3-TERMINAL PERM-A-SEAL SENSING ELEMENT REMOTE OR INTEGRAL

700-1202-21-CD SHT. 1 OF 1 ISS. 3

440-115-184 121

NO. 700-1202-001-CD SHT 1 OF 1