



NOTICE
THIS DRAWING IS THE PROPERTY OF QUALITROL CORP. ANY USE OR REPRODUCTION OF THIS DRAWING FOR ANY PURPOSE NOT AUTHORIZED BY QUALITROL CORP. IS PROHIBITED. ANY REPRODUCTION OF THIS DRAWING WITHOUT THE WRITTEN PERMISSION OF QUALITROL CORP. IS PROHIBITED. ANY REPRODUCTION OF THIS DRAWING WITHOUT THE WRITTEN PERMISSION OF QUALITROL CORP. IS PROHIBITED.

MODEL
NO. ITM505-00223152

DIMENSIONS ARE FOR REFERENCE ONLY.
DIMENSIONS ARE IN INCHES [MILLIMETERS].

SUGGESTED CUTOUT: 7.8 [198.1] WD x 9.3 [236.2] HI.
SUGGESTED MOUNTING HARDWARE: 1/4 INCH BOLTS.


INPUT SLOT MODULE

INPUT SLOT #1: PT100
INPUT SLOT #2: WINDING/5A
INPUT SLOT #3: PT/AMB/RTD
INPUT SLOT #4: EMPTY

FRONT PANEL DESIGNATION

RELAY #1: FANS RUNNING
RELAY #2: WINDING TEMP ALARM
RELAY #3: LIQUID TEMP ALARM
RELAY #4: LIQUID LEVEL ALARM

HEATER OPTION: NOT INCLUDED
COMMUNICATIONS OPTION: RS485, WITH STANDARD WIRED INTERFACE.
PROTOCOL OPTION: DNP 3.0 [LEVEL 3 SLAVE] (RS-485) INCLUDED
CT TEMPERATURE SCALING OPTION: FULL THERMAL MODELING
(ADVANCED CALCULATION #1)
SEASONAL COOLING SETBACK: NOT INCLUDED
AMBIENT TEMPERATURE FORECAST CONTROL: NOT INCLUDED
CONFIGURATION FORM: 309

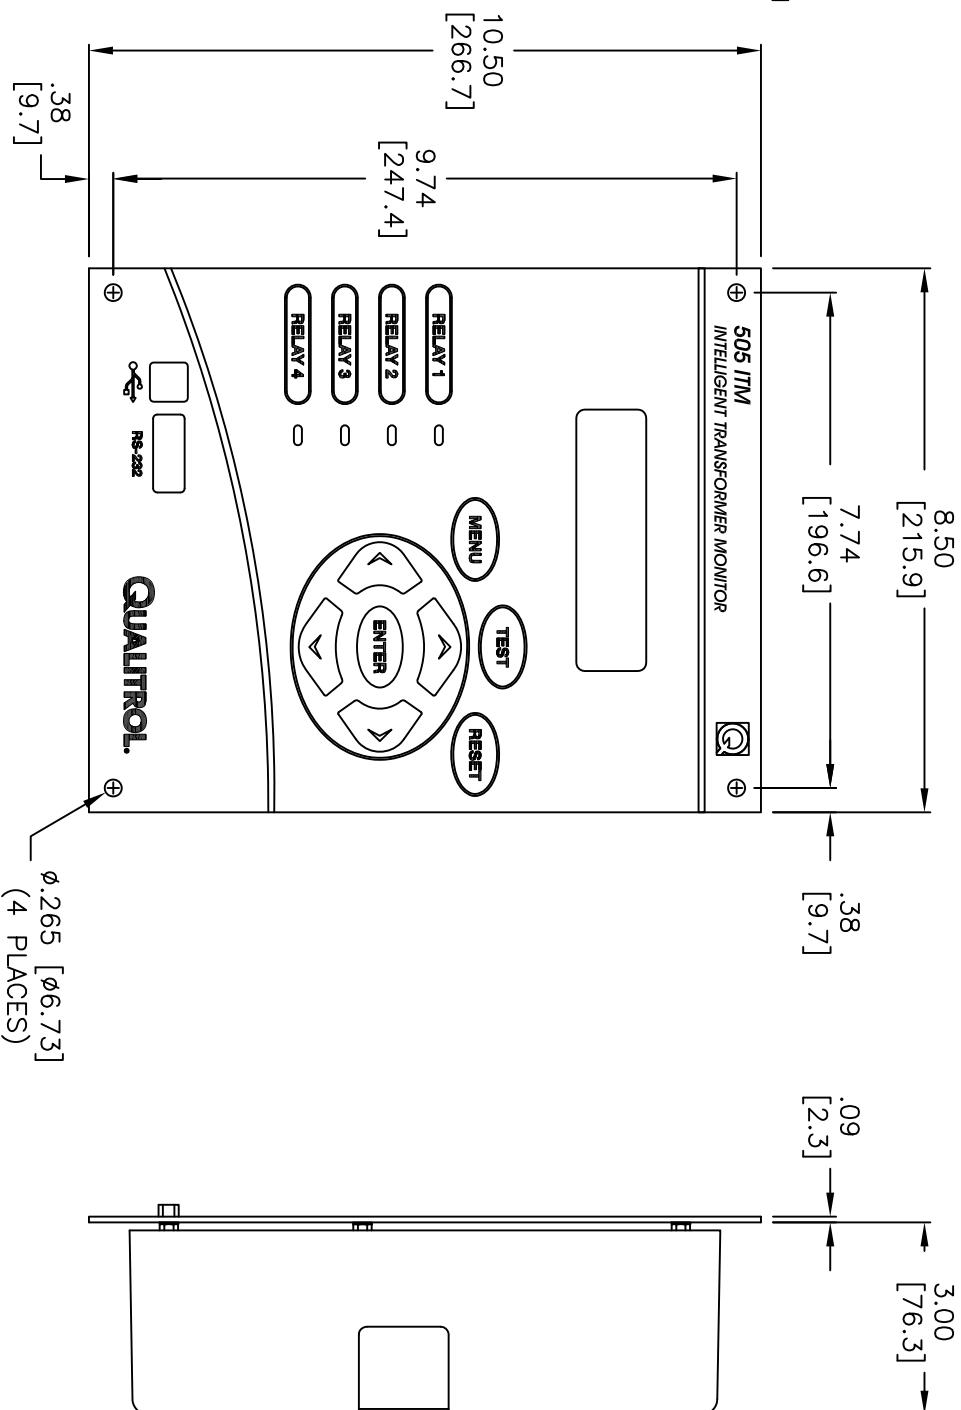


SHEET 1 OF 2

LET	DATE	DRAWING CREATED	ALTERATION	C.N.	TITLE: INTELLIGENT TRANSFORMER MONITOR-PANEL MOUNT	MODEL NO. ITM505-00223152
-	9-26-12	DRAWING CREATED	-	-	PH. (585) 586-1515 FAX (585) 377-0220 1385 FAIRPORT ROAD FAIRPORT, NY 14450	
					FORM 0-473 REV. F 04/06/06	



MODEL
NO. ITM505-00223152

(LOCATED ON REAR COVER)

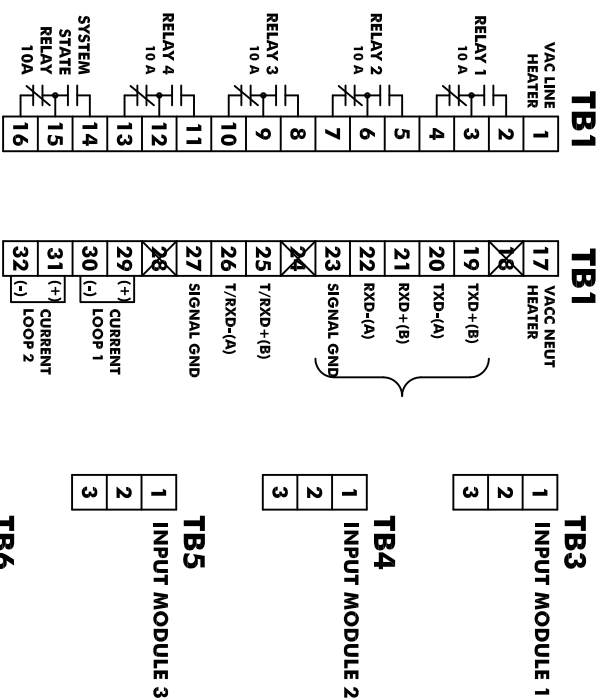

MODEL NO. []
SERIAL NO. []
MFG. DATE []

PH. (585) 586-1515
FAX (585) 377-0220
1385 FAIRPORT ROAD
FAIRPORT, NY 14450
0-473 REV. F 04/06/06

MODEL
NO. ITM505-00223152