

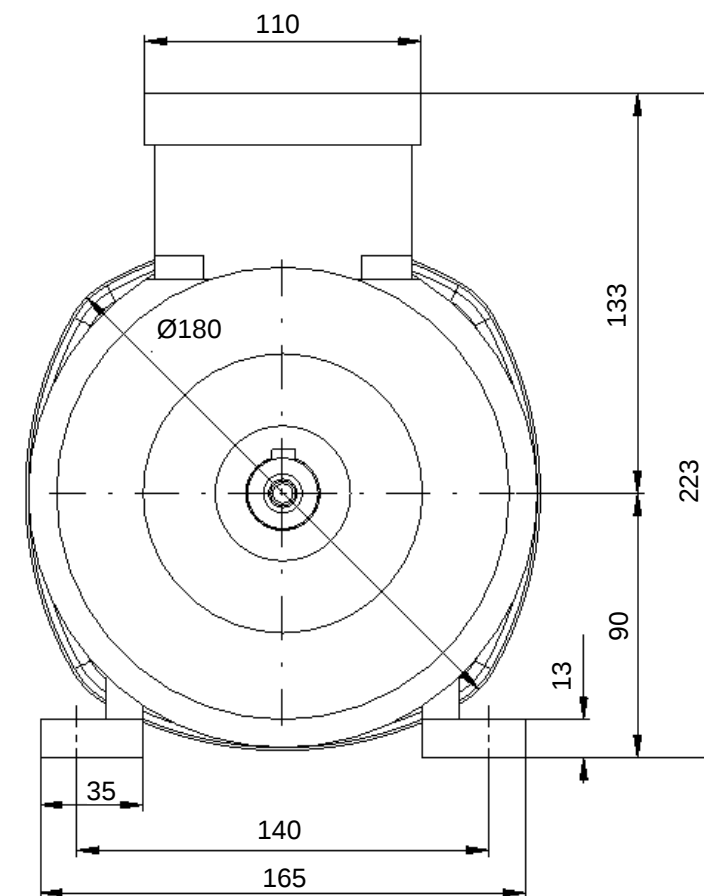


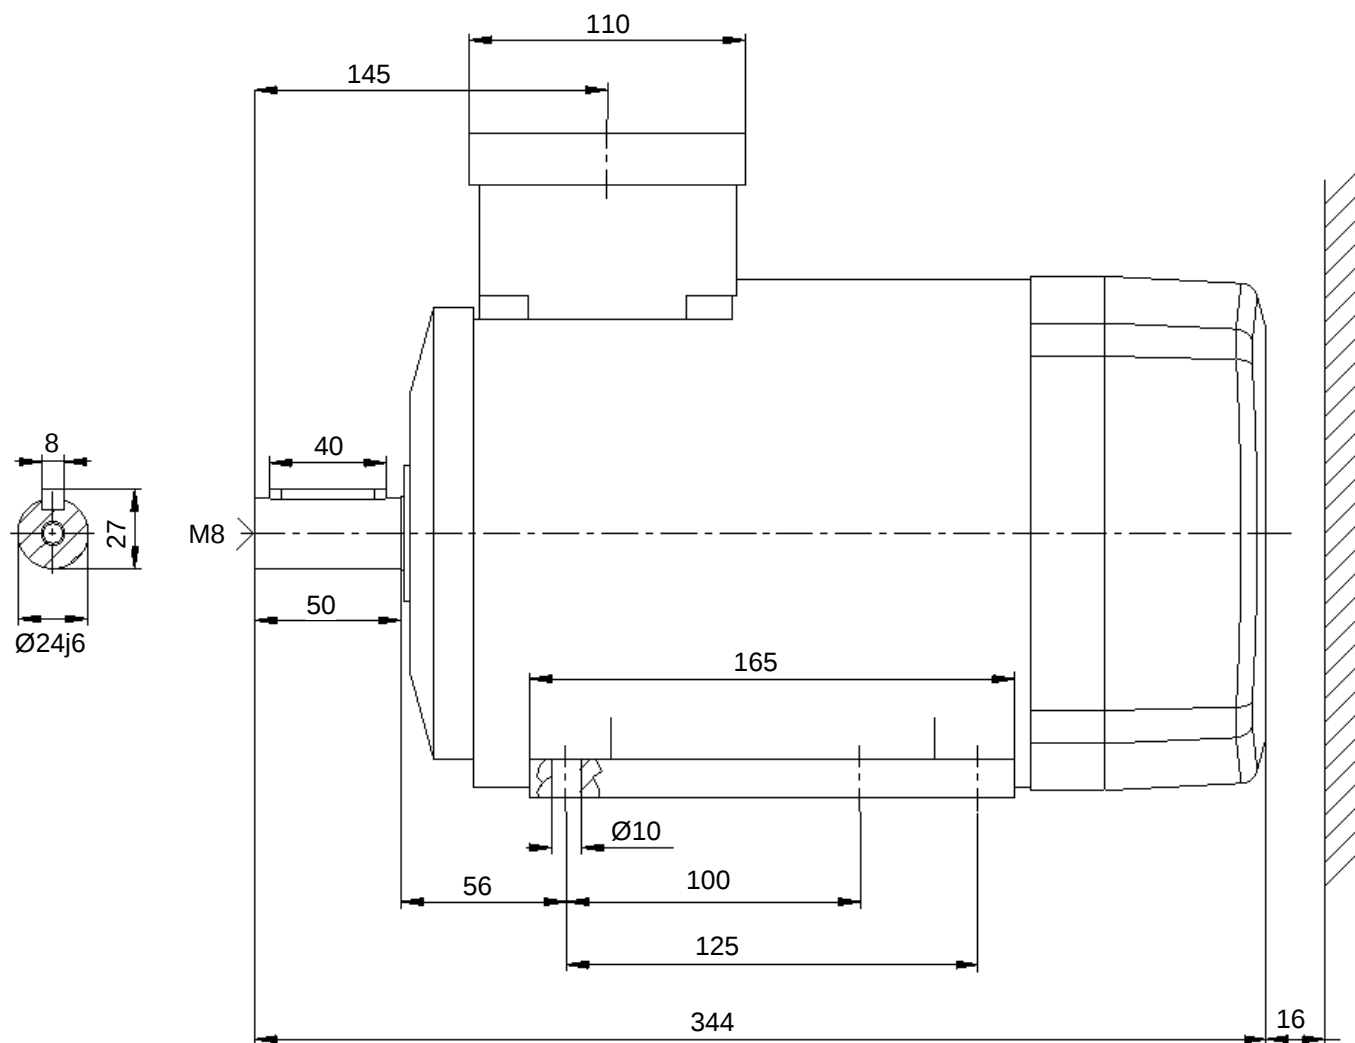

Maßblatt - #303532 - KTE 90 S 2 KT IE3 ULcsa QH in Angebot An181809 Position 1

Kabelabgang / cable outlet

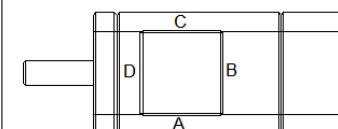

Standard = A

09.01.2026