NOTICE

THIS DRAWING IS THE PROPERTY OF QualiTROL CORPORATION AND IS LOANED ONLY ON THE CONDITION THAT IT WILL BE USED TO FACILITATE THE PURPOSE FOR WHICH INTENDED AND NOT BE REPRODUCED, COPIED OR OTHERWISE DISPOSED OF, AND IS NOT TO BE USED IN WHOLE OR PART FOR FURNISHING INFORMATION RELATIVE TO THE MAKING OF DRAWINGS, PARTS APPARATUS OR PARTS THEREOF, EXCEPT BY WRITTEN ORDER FROM QualiTROL CORPORATION.

MODEL NO. SWT-612


NOTE:


1.) UNIT PASSES HI-POT TEST;
2000 VOLTS BETWEEN CONNECTOR TERMINALS AND GROUND FOR 60 SECONDS.


SWITCH OPERATION:

-WHEN ALARM SWITCH IS MOUNTED ON PRESSURE RELIEF DEVICE, BLACK AND WHITE ARE CLOSED.
-SHOULD THE MECHANICAL RELIEF DEVICE BE CALLED UPON TO OPERATE; WHITE OPENS ON BLACK AND CLOSES ON GREEN.
-BLACK AND WHITE WILL REMAIN OPENED UNTIL SWITCH RESET LEVER IS MANUALLY DEPRESSED.

SWITCH RATINGS FOR SWT-612-1 THRU 4
ENEC/CQC: 11(3) A, 125/250 VAC
UL/cUL: 11(3)A, 125/250 VAC
UL CARD FILE: E12252

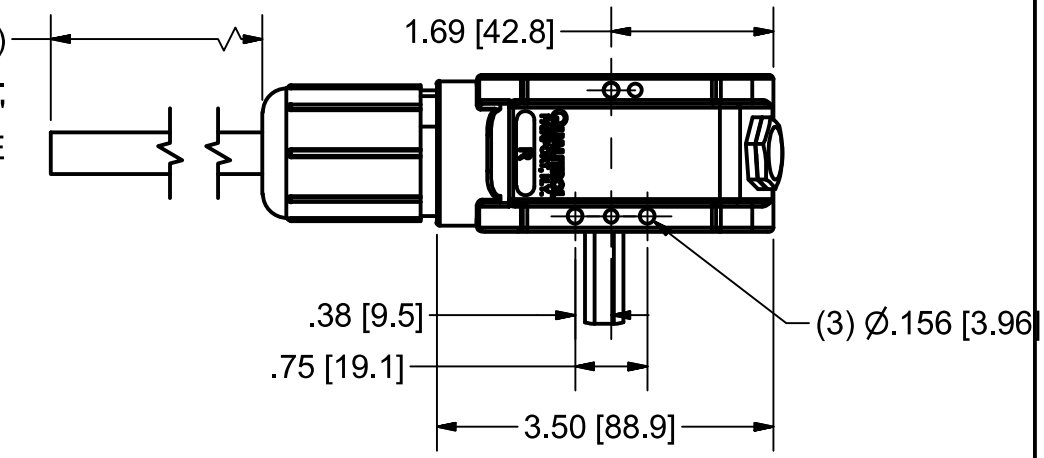

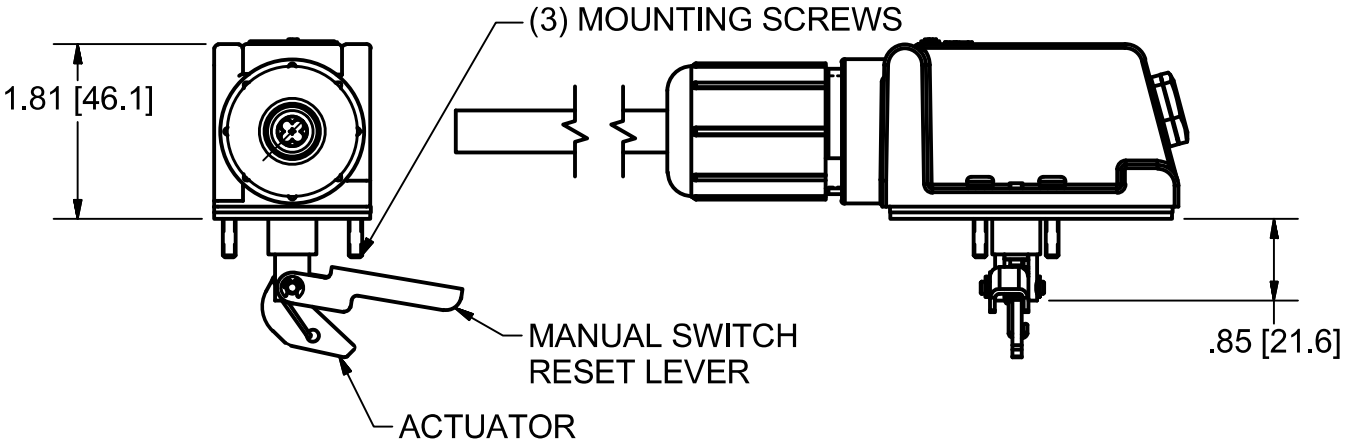

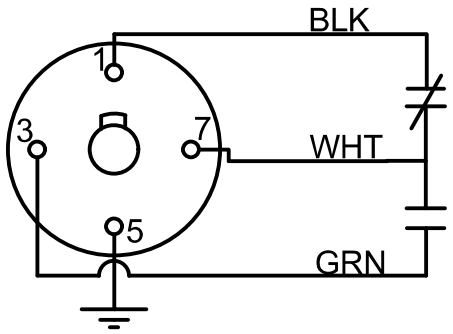

DEV-WIR-4Q01
SHOWN IN NON-ALARM STATE

REVISION	PART NO.	"L"	SWITCH RATING	REMARKS
34603 5-4-17	SWT-612-4	-	11A @ 125/250 VAC	CAPLUG ONLY
34603 5-4-17	SWT-612-3	80.00	11A @ 125/250 VAC	
34603 5-4-17	SWT-612-2	48.00	11A @ 125/250 VAC	
34603 5-4-17	SWT-612-1	0.00	11A @ 125/250 VAC	CONN. W/0 CABLE

SHEET 1 OF 2 , SHEET 2 AND HIGHER FOR INTERNAL REF ONLY!

LET	DATE	ALTERATION	C.N.
-			
-	5-4-17	VNT-014-3 WAS VNT-013-1	34603
-	7-3-13	PT.-4: ADDED IP65 VENT TO ALARM SWITCH	31508

QUALITROL®
PH. (585) 586-1515
FAX (585) 377-0220
1385 FAIRPORT ROAD
FAIRPORT, NY 14450

DIMENSIONS AND TOLERANCES IN ACCORDANCE WITH ASME Y14.5M-1994

FORM 0-473 REV.D 10/22/02

TITLE: ALARM SWITCH

MODEL NO. SWT-612